


Product manual

# **FDC-DD**


Fire damper


Fire protection

Version 1.0.0 Issue Date: 11.07.2022.

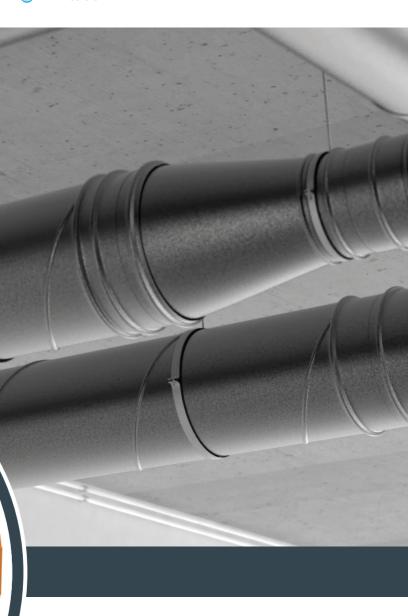



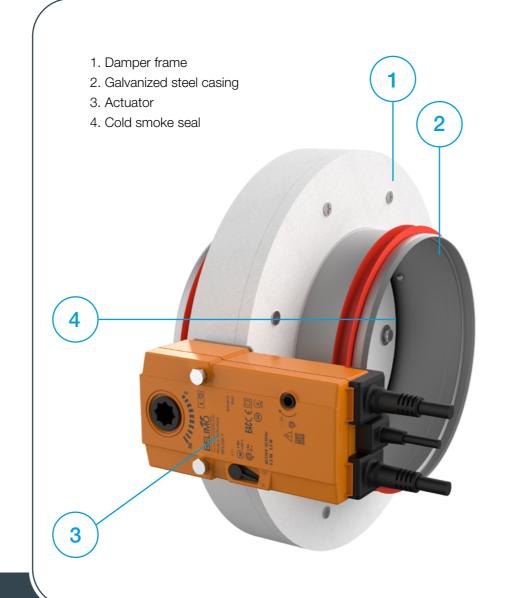

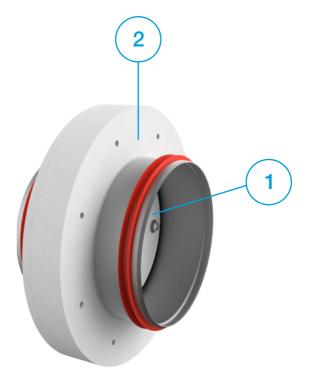

1. Fire resistant damper blade 2. Installation contact layer/side

PRODUCT OVERVIEW

# **PRODUCT OVERVIEW**

trough the ventilation ducts and between the fire sections. Fire (24V or 230V versions). Actuator's spring closes the damper damper FDC-DD consists of galvanized sheet metal casing, calcium silicate damper blade, high temperature resistant has reached 72 °C. Closing and reopening of damper blade insulation frame made from calcium silicate and electric actuator. can also be done remotely via control signal.

Fire damper casing is made out of galvanized steel sheet. Variants Declared blade tightness - class 3 and casing tightness - class C produced from stainless steel and powder coated steel are also are tested according to EN 1751. available. Calcium silicate blade is equipped with brass bearings and seals. Brass bearings are pressed into the casing. Calcium silicate blade is equipped with the seal made out of EPDM rubber.

Fire dampers FDC-DD are produced up to size d315 and have 25 mm thick damper blade.

Fire dampers FDC-DD are used for prevention of fire spread Fire dampers are equipped with Belimo electric actuators blade when it's thermal fuse senses the ambient temperature

#### PRODUCT OVERVIEW DIMENSIONS **INSTALLATIONS ACTUATORS ACCESSORIES** MAINTENANCE AND OPERATION





PRODUCT OVERVIEW

# FIRE RESISTANCE CLASSIFICATION

FDC-DD fire resistance is tested according to EN 1366-2 "Fire resistance tests for service installations- Part 2: Fire dampers". Classification of the fire dampers is defined according to EN 13501-3 Fire classification of construction products and building elements.

Installation in both, vertical and horizontal axis of rotation of the dampers blade is acceptable (with the axis angle 0 - 360°).

Fire resistance of fire damper depends on classification of walls or ceilings. It is allowed to install products to walls or ceilings only according to products Declaration of Performance. Walls

or ceilings with greater fire resistance can also be used. Fire

damper should be installed according to the installation manual

which can be found within this document.

Please consult latest Declaration of Performance:



www.solid-air.com/downloads

For more information about certificates, visit our website:


#### www.solid-air.com/downloads


- E Integrity.
- Insulation.
- **60** Classification time in minutes.
- S Smoke leakage.
- ve Damper installed in vertical compartment.
- ho Damper installed in horizontal compartment.
- $i \leftrightarrow o$  Fire performance criteria are met on both sides.

# PRODUCT OVERVIEW DIMENSIONS INSTALLATIONS ACTUATORS ACCESSORIES MAINTENANCE AND OPERATION





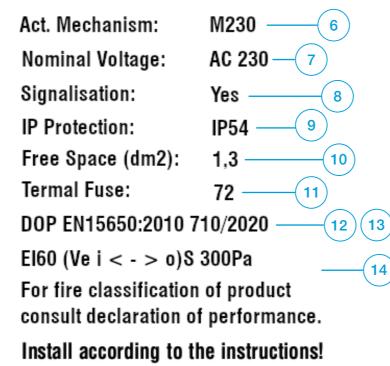





**USER MANUALS** 

# **TECHNICAL DATA**

Fire damper casing is manufactured from galvanized steel sheet, but on demand can be produced out of:

- Galvanized steel and powder coated.
- Stainless steel EN 1.4301/EN 1.4404 (AISI 304/316L).
- Stainless steel EN 1.4301/EN 1.4404 (AISI 304/316L) and powder coated.

### Product label

- 1 Casing air leakage classification
- 2 Serial number
- 3 Production date
- 4 Type
- 5 Dimension of the fire damper
- 6 Mechanism type
- 7 Nominal voltage
- 8 - Signalisation (end contacts)
- 9 IP protection
- 10 Free space
- 11 Thermal fuse temperature
- 12 Number of the European standard and year of its publication
- 13 Declaration of performance
- 14 Classification according to EN 13501-3
- 15 Barcode
- 16 CE mark

# **Product specifications**

Nominal sizes FDC-DD	100 - 315 (mm)
Casing length	170 mm
Temperature range	-20 °C 50 °C
Release temperature	72 °C (standard)
Volume flow rate range	up to 21700 m <sup>3</sup> /h
Differential pressure range	up to 600 Pa
Casing air leakage	Class C, EN 1751
Closed blade air leakage	Class 3, EN 1751
Upstream velocity	< 12 m/s
EC conformity	EN 1751
Declaration of performance	DoP 717/2022

# Pressure drop tables

Pressure drop values are described with the "Zeta" values for each size. The exact pressure drop in (Pa) is calculated using the following formula:

#### $\Delta p (Pa) = \zeta * v^2 * 0.6$

where  $\zeta$  is Zeta value from the tables below, v is airflow velocity in (m/s).

FDC-DD	d100	d125	d160	d200	d250	d315
ζ	1,759	0,852	0,545	0,445	0,340	0,293



PRODUCT OVERVIEW  $\mathbf{\nabla}$ DIMENSIONS  $\mathbf{\nabla}$  $\mathbf{\nabla}$ **INSTALLATIONS ACTUATORS**  $\mathbf{\nabla}$ ACCESSORIES  $\mathbf{\nabla}$  $\mathbf{\nabla}$ **REPLACEMENTS** MAINTENANCE AND OPERATION



**MODELS** Casings

#### FDC-DD

Cylindrical fire damper with 25 mm damper blade and fire classification up to El60. Sizes range from d100 till d315.





### PRODUCT OVERVIEW

#### **Actuators**

#### M230-S

Belimo 230 V electro motor operating mechanism, comes with integrated end switches. In case of fire, the fire damper closes automatically. Damper closing can be initiated either by thermoelectric release device or remotely by triggering the electro motor. Upon closure, damper blade is locked in closed position and can be opened by sending a signal to electro motor. Standard thermoelectric release point is 72 °C.

#### M24-S

Belimo 24 V electro motor operating mechanism, comes with integrated end switches. In case of fire, the fire damper closes automatically. Damper closing can be initiated either by thermoelectric release device or remotely by triggering the electro motor. Upon closure, damper blade is locked in closed position and can be opened by sending a signal to electro motor. Standard thermoelectric release point is 72 °C.

#### M24-S-ST


Belimo 24 V electro motor operating mechanism, comes with integrated end switches. In case of fire, the fire damper closes automatically. Damper closing can be initiated either by thermoelectric release device or remotely by triggering the electro motor. Upon closure, damper blade is locked in closed position and can be opened by sending a signal to electro motor. Standard thermoelectric release point is 72 °C. Actuator is additionally equipped with connection plug for easy connection with power supply and communication modules.

# Ordering key

#### (1) Damper type

#### FDC-DD -

- (1) FDC-DD
- (2) Damper diameter d100 till d315
- (3) Actuator type:



## FIRE DAMPER - FDC-DD

(2) Dimension (3) Actuator type

d250 -M230-S


- M230-S Electric actuator AC/DC 230V.
- M24-S Electric actuator AC/DC 24V.
- M24-S-ST Electric actuator AC/DC 24V with connection plug.



# FDC - DD

# **Dimensional range**

Diameter (mm)	Cross section (dm²)	Net area (dm²)
100	0,74	0,50
125	1,17	0,87
160	1,93	1,55
200	3,05	2,56
250	4,79	4,18
315	7,64	6,87

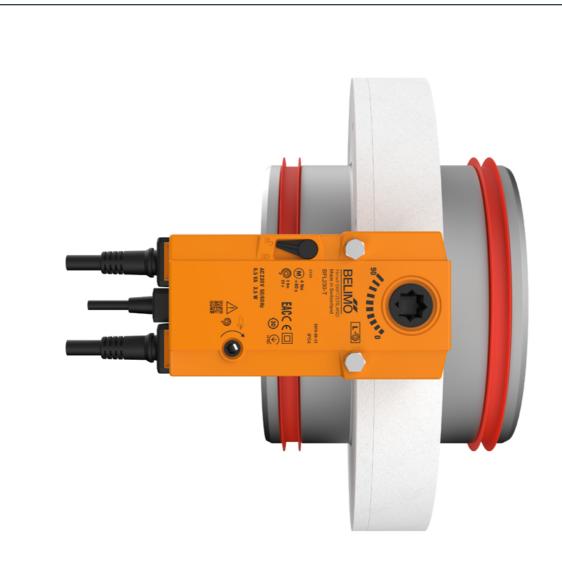



DIMENSIONS

1

## Weights (with Belimo actuator 1,1 kg)

Dimension (mm)	Weight (kg)
FDC-DD D100	3,022
FDC-DD D125	3,389
FDC-DD D160	3,94
FDC-DD D200	4,619
FDC-DD D250	5,547
FDC-DD D315	6,879

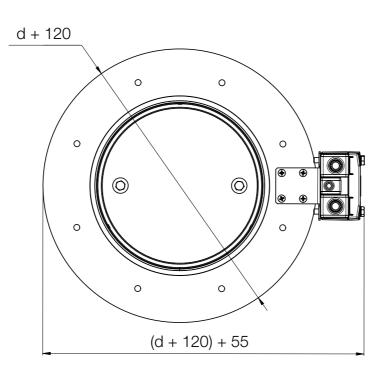

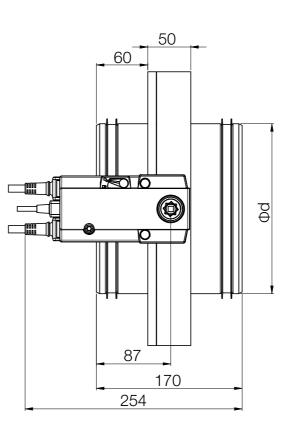


# PRODUCT OVERVIEW DIMENSIONS INSTALLATIONS ACTUATORS ACCESSORIES MAINTENANCE AND OPERATION



# **INSTALLATION**

The FDC-DD fire damper is always tested in standardized support frames (both in a rigid wall and in a flexible wall) in accordance with EN 1366-2: 2015. The results obtained are valid for all similar support frames which have a thickness and/ or density and/ or fire resistance similar or greater than the one on the test.

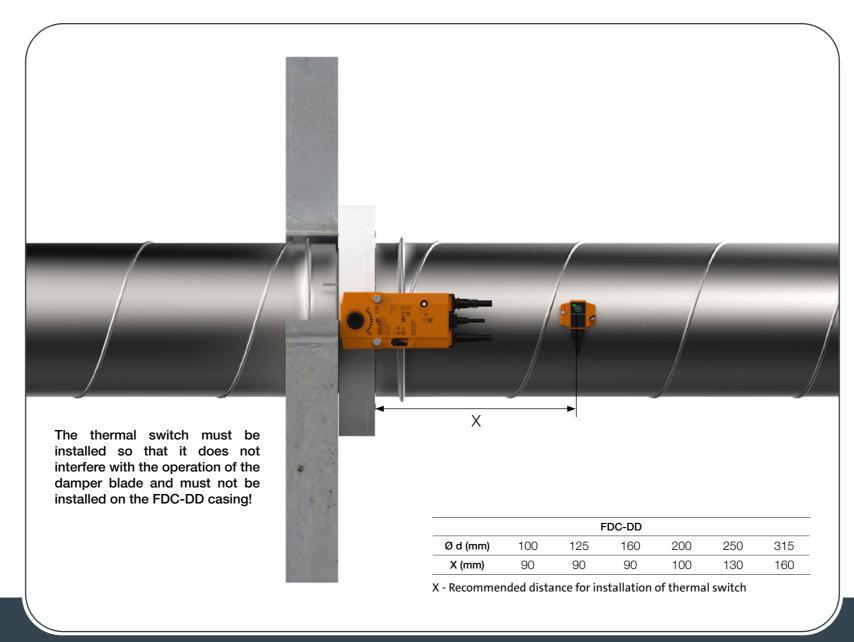

#### Refe **INSTALLATIONS**

hung in such a way that the damper does not carry its weight. The damper must not support any part of the surrounding construction or wall which could cause damage and consequent damper failure. It is recommended to connect the damper with a flexible connection on either end of the damper.

The damper driving mechanism can be placed on either side of the wall, however it needs to be placed in such way that it ensures an easy access during inspection.


- Mounting is possible with the blade axis in horizontal or in vertical position.
- performed during certification.
- Avoid any obstruction of the moving blade by the connected ducts.
- The class of air-tightness is maintained in case the installation of the damper is made in accordance with the technical manual.
- Operating temperature: 50 °C max.
- For indoor use only.

The duct connected to the fire damper must be supported or The gap in the installation opening between the fire damper and the wall/ceiling can be increased by up to 50 %, or decreased to the smallest dimension where there is sufficient room for installation of the seal!


Recommended opening dimensions:

Damper size - Ød (mm)	Gap size - A (Recommended)	Opening size - Ød + 2A (Recommended)
Ød	2.5 mm	Ø d + 5 mm

Installation in both, vertical and horizontal axis of rotation of the The installation must comply with the tests that were dampers blade is acceptable (with the axis angle 0 - 360°).

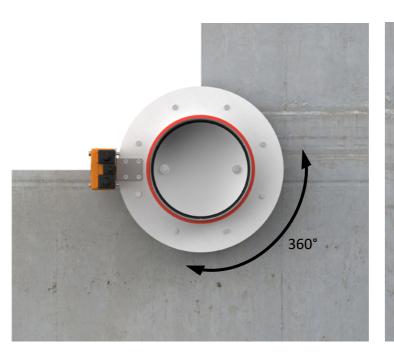

#### PRODUCT OVERVIEW DIMENSIONS **INSTALLATIONS ACTUATORS ACCESSORIES** MAINTENANCE AND OPERATION

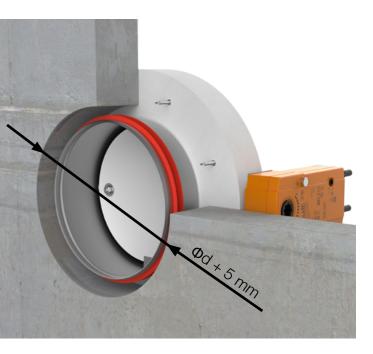

Range	Supporting construction	Wall thickness	Supporting construction details	Type of installation	Classification	Tested underpressure	Details	Construction type	Sealing type
	Rigid wall	≥ 100 mm	Aerated concrete (≥ 550 kg/m³) Reinforced concrete (≥ 2200 kg/m³)	Installation frame	El 60 (ve i↔o)S	300 Pa	$\bigcirc$		$\bigcirc$
0		≥ 70 mm	Gypsum blocks (≥ 995 kg/m³)	Installation frame	El 60 (ve i↔o)S	300 Pa	$\bigcirc$		9
FDC-DD	Flexible wall	≥ 100 mm	A: Plasterboard type F (EN520), mineral wool up to 60 kg/m <sup>3</sup> B: Plasterboard type A (EN520), mineral wool up to 60 kg/m <sup>3</sup>	Installation frame	El 60 (ve i⇔o)S	300 Pa			9



Check for more information about certificate installations in the declaration of performance:



www.solid-air.com/downloads



Aerated concrete (  $\geq$  550 kg/m<sup>3</sup>) or reinforced concrete ( $\geq$  2200 kg/m<sup>3</sup>) wall, more than 100 mm thick



Gypsum blocks (≥ 995 kg/m³) wall, more than 70 mm thick



Plasterboard wall, type F (EN520), Plasterboard wall, type A (EN520), more than 100 mm thick

### FIRE DAMPER - FDC-DD



FDC-DD installation



# Rigid wall installation

The wall is composed of concrete blocks (minimum density of 550 kg/m<sup>3</sup>) or reinforced concrete (minimum density of 2200 kg/m<sup>3</sup>) and with a minimum thickness of 100 mm.





# INSTALLATIONS

# Damper blade must be closed during installation!


1. Create a wall opening according to the dimensions in drawing below.


2. Before installing the damper on the wall, it is necessary to apply a thin strip of silicone to the contact layer of calcium silicate.

3.Insert fire damper into the wall and fasten with screws (8 pcs, 6 x100 mm).

Test the operation of the damper blade!




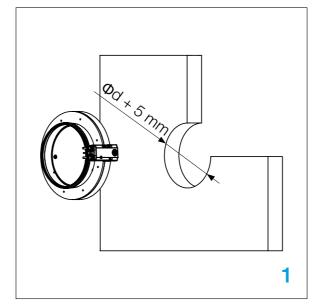

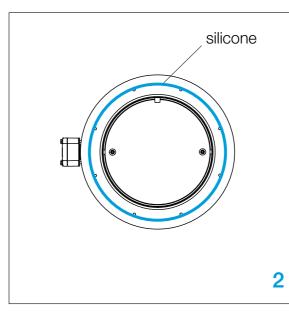



### FIRE DAMPER - FDC-DD

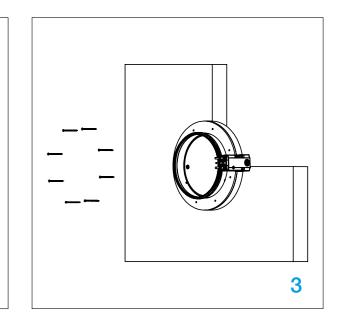

9



# Gypsum blocks wall installation

The wall is composed of gypsum blocks (minimum density of 995 kg/m<sup>3</sup>), and with minimum thickness of 70 mm.

1.2.2





# INSTALLATIONS


# Damper blade must be closed during installation!


1. Create a wall opening according to the dimensions in drawing below.

2. Before installing the damper on the wall, it is necessary to apply a thin strip of silicone to the contact layer of calcium silicate.

3. Insert fire damper into the wall and fasten with screws (8 pcs,  $6 \times 100$  mm).


Test the operation of the damper blade!

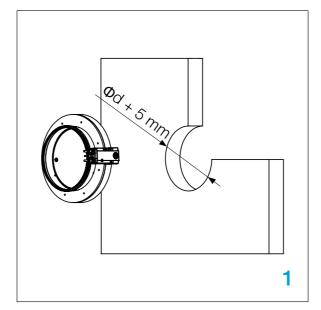

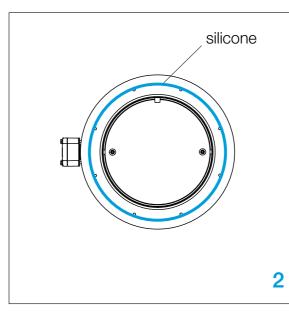



### FIRE DAMPER - FDC-DD

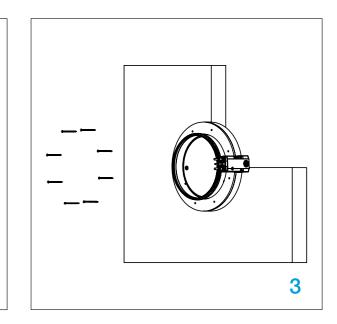

10



# Flexible wall installation

The wall is composed of  $2 \times 2$  plasterboard boards, 12,5 mm thick, installed on a steel frame construction. To fulfill the classification it is **NOT** mandatory to use the mineral wool inside the wall (mineral wool with density up to 60 kg/m<sup>3</sup> can be used). The minimum thickness of the wall is 100 mm.





# INSTALLATIONS

# Create subframe for instalation in flexibile wall! (page 12)

# Damper blade must be closed during installation!


1. Create a wall opening according to the dimensions in drawing below.


2. Before installing the damper on the wall, it is necessary to apply a thin strip of silicone to the contact layer of calcium silicate.

3. Insert fire damper into the wall and fasten with screws (8 pcs,  $6 \times 100$  mm).

Test the operation of the damper blade!




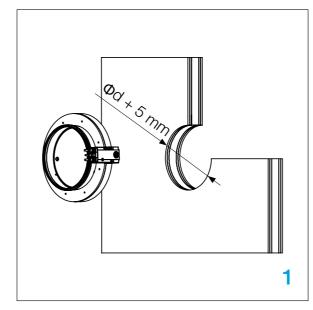

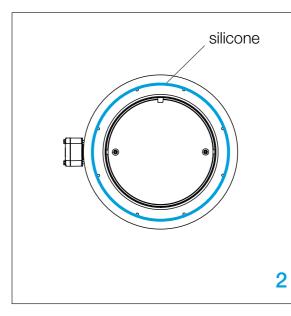




### FIRE DAMPER - FDC-DD

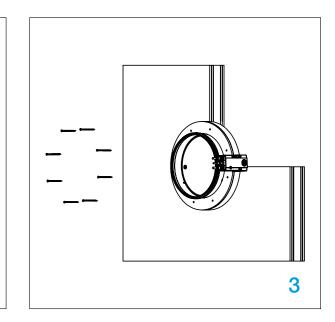

11

# Minimal installation distances

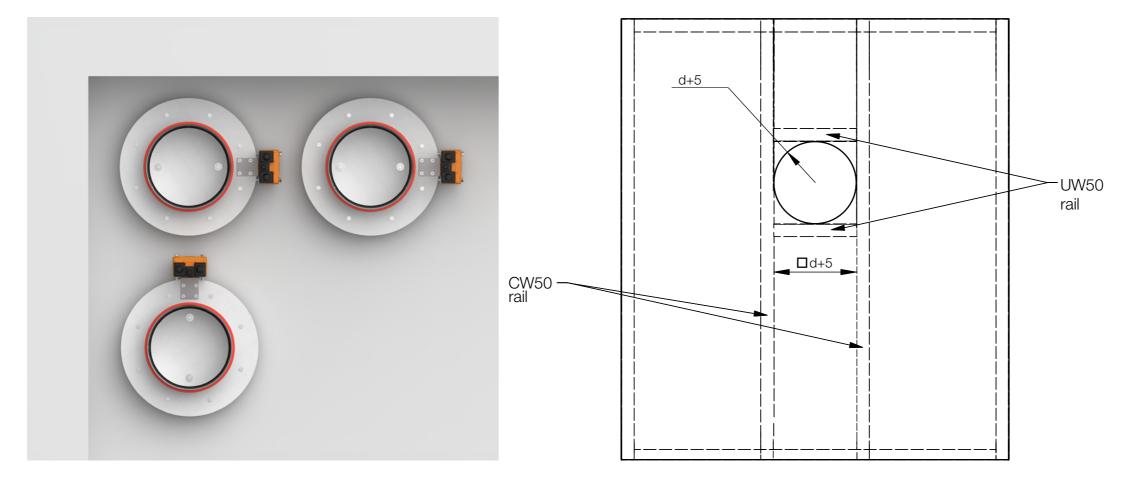

# Subframe for installation in flexible wall



PRODUCT OVERVIEW
DIMENSIONS
INSTALLATIONS
ACTUATORS
ACCESSORIES
REPLACEMENTS
MAINTENANCE AND OPERATION





# ELECTRIC ACTUATOR M24-S, M230-S, M24-S-ST

Damper is delivered in closed position. When electric actuator is connected to the power supply, damper blade will open. When the damper reaches the end position (damper open), the electro motor will stop. Closing fire damper takes place automatically when a power failure occurs. Thermal tripping device that comes with fire damper causes power circuit break at a temperature of 72 °C (optional 95 °C). If checking is needed for proper functioning of fire damper, pushing the switch on the thermal tripping device will close damper.



 $\bigcirc$ 

BFL230

(M) 4 Nm < 60 s

0 3 Nm 20 1

AC 230 V 50/60 Hz 6.5 VA 3.5 W  $\bigcirc$ 

L-0

EACCE

# ACTUATORS


When switch on tripping device is released, the damper will open. Damper can be opened without connecting to a voltage with enclosed handle by turning it in the direction of the arrow on electric actuator (clockwise). Damper can be locked in the desired position by fast turning handle a quarter of a turn (counterclockwise) for Belimo BF, and by puling brake on Belimo BFL and BFN.

To unlock the electro motor, turn handle clockwise for a quarter of a turn for Belimo BF, or release brake for Belimo BFL and BFN. After release, damper will be closed by return spring. When damper is opened manually, electric actuator will not move the damper into closed position in case of power failure.

## **Technical specifications**

Type of Belimo actuator		BFL24-T	BFL230-T
Nominal voltage /	voltage	AC/DC 24 V, 50/60 Hz	AC 230 V, 50/60 Hz
power	opening	2,5 W	3,5 W
con- sumption	holding 0,8 W		1,1 W
oumption	for wire sizing	4 VA	6,5 VA
End switch		1 mA3 A (0.5 A), DC 5 VAC 250V	1 mA3 A (0.5 A), DC 5 VAC 250 V
Running	motor	< 60 s	< 60 s
time	spring return	~20 s	~20 s
Ambient temperature range		min	-30 °C, max. 50 °C

#### Wiring diagram

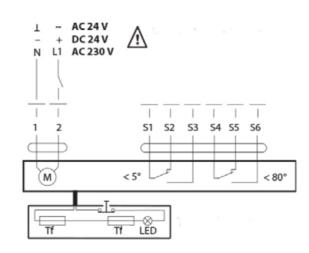

# PRODUCT OVERVIEW DIMENSIONS INSTALLATIONS ACTUATORS ACCESSORIES MAINTENANCE AND OPERATION


1	negative (direct-current) or neutral (alternating current)
2	positive (direct-current) or faze (alternating current)
S1	common micro switch closed damper
S2	normally closed micro switch closed damper
S3	normally open micro switch closed damper
S4	common micro switch open damper
S5	normally closed micro switch open damper
S6	normally open micro switch open damper
Tf	temperature sensor on the outer side of the duct (ambient temperature) max. 72 °C



# ACCESSORIES

E Flexible duct connections - Flexible duct connectors are used in HVAC systems for isolation from structure-borne noise, expansion compensation and fire damper connections (total length 150 mm, flexible 60 mm).

F Safety grilles - Fire damper, safety grille and, if applicable, extension piece are assembled at the factory to form a unit. The free cross sectional area of the cover grille is approx. 70 %.

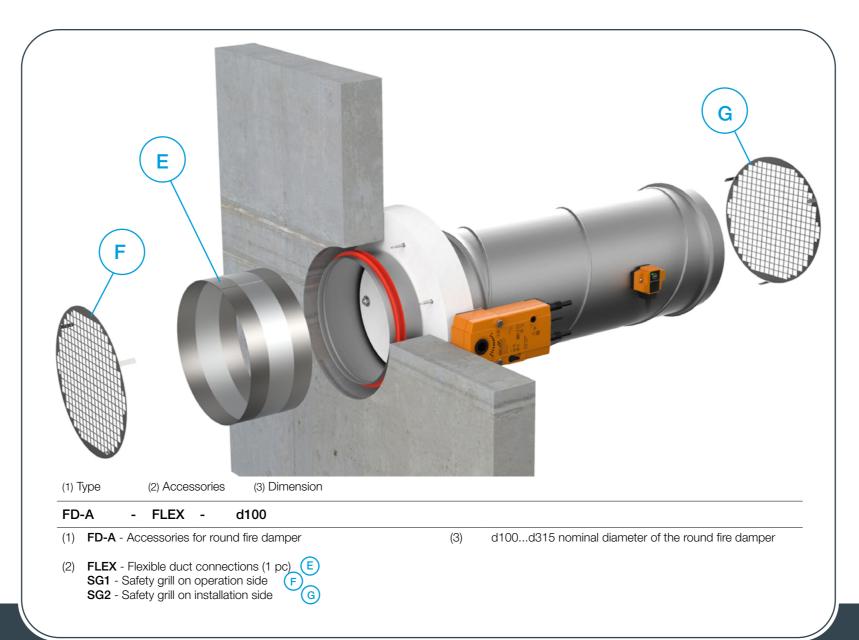

#### 

- For safety reasons, parts need to be changed by a trained personnel or the manufacturer.
- WARNING! Install the original parts only!
- A Communication module bracket FD-A-CMB
- B Belimo thermal fuse 72 °C FD-A-BAT72
- C Thermal fuse blanking plate FD-BP-KIT



# PRODUCT OVERVIEW DIMENSIONS INSTALLATIONS ACTUATORS ACCESSORIES MAINTENANCE AND OPERATION





#### MAINTENANCE AND OPERATION

# TRANSPORT

After arrival, check the fire damper for transport damage and shortcomings. In case of any damage or shortcomings, immediately contact your supplier.

# STORAGE

If the damper is not installed immediately:

- Remove any wrapping.
- Protect fire damper from dust and contamination.
- Do not expose the fire damper to the effects of weather store fire damper in dry place.
- Do not store the unit below -20 °C or above 50 °C.

Please properly dispose of packaging material.

# MAINTENANCE AND OPERATION

Fire dampers are designed with fully enclosed drive mechanism outside of the duct and as such do not require cleaning and regular maintenance.

However, activation mechanism should be inspected for proper operation on regular basis.


- Provide at least one annual check of the damper.
- After each intervention, provide a systematic cleaning of dust.
- Check if the electrical terminals are tightened.
- Cleaning instruction: clean with a sponge, with water or a mild detergent.
- Disinfection instruction: spray disinfectant (desinfectant may contain alcohol which is flammable, take precaution to avoid ignition).

It is not permitted to alter the dampers in any way nor perform any changes to their structure (except for the service procedures described in this manual) without the manufacturer's consent. Provide at least one annual check of the damper.

The functional test must be carried out in compliance with the basic maintenance principles of the European norms EN 13306, EN 15423 and EN15650.

# COMMISSIONING

- Carefully unpack FDC-DD fire damper be careful of sharp edges and do not use excessive force for unpacking.
- Inspect the fire damper check the fire damper for damage.
- Installation of the fire damper according to the installation instructions (page 7).
- Before commissioning: check the fire damper functions.

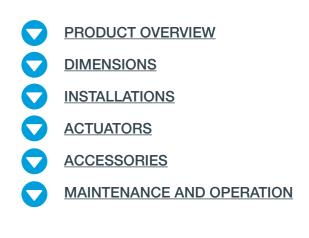

# FIRE DAMPER - FDC-DD

# **FUNCTIONS**

Release mechanism: Damper blade can be closed and opened manually. Electric actuator: Signal testing - the damper blade must close/open.



- Scheepswervenweg 1, 9608 PD Westerbroek
- **♦** +31 598 361 221
- ⊠ contact@solid-air.nl
- www.solid-air.nl